

SPECIFICATION

(for Approval)

Commodity	Low Voltage Power Capacitor (OIL-TYPE)
Rating	720AC 3P 50Hz 10 ~ 50KVAR
Part NO.	SEE DRAWING

Approved	

Prepared	Checked	Approved
KEMIKA K.	SAMPAN M.	S.N.KIM

SPECIFICATION	CAPACITOR UNIT	1 / 7																																																						
<div>1. Scope</div> <p>This specification covers the design, manufacture and test of low voltage power capacitor unit intended to be used particular for power factor correction AC Power System.</p> <div>2. Type and Ratings</div> <table><tr><td>Type</td><td>SEE DRAWING</td></tr><tr><td>Rated voltage [V]</td><td>720</td></tr><tr><td>Rated capacity [kvar]</td><td>SEE DRAWING</td></tr><tr><td>Phase [Φ]</td><td>3</td></tr><tr><td>Frequency [Hz]</td><td>50</td></tr><tr><td>Installation</td><td>INDOOR</td></tr><tr><td>Protection</td><td>IP20</td></tr><tr><td>Impregnation</td><td>CAPACITOR Oil (Non PCB)</td></tr></table> <div>3. Service Conditions</div> <table><tr><td>Residual voltage at energization</td><td colspan="4">Not to exceed 10% of rated voltage</td></tr><tr><td>Altitude</td><td colspan="4">Not exceeding 2,000m</td></tr><tr><td>Location</td><td colspan="4">Indoor</td></tr><tr><td>Ambient air temperature</td><td colspan="4">Please see following Table</td></tr></table> <table><tr><th rowspan="3">Symbol</th><th colspan="4">Ambient air temperature [°C]</th></tr><tr><th rowspan="2">Maximum</th><th rowspan="2">Minimum</th><th colspan="2">Highest mean over any period of</th></tr><tr><th>24 h</th><th>1 year</th></tr><tr><td>B</td><td>+45</td><td>-25</td><td>+35</td><td>+25</td></tr></table> <p>Attention should be paid to the upper operating temperature of the capacitor, because this has a great influence on its life.</p> <p>When the capacitor dielectric reaches a temperature below the lower limit of its category, there may be the danger of initiating partial discharges in the dielectric when the capacitor is initially energized.</p>					Type	SEE DRAWING	Rated voltage [V]	720	Rated capacity [kvar]	SEE DRAWING	Phase [Φ]	3	Frequency [Hz]	50	Installation	INDOOR	Protection	IP20	Impregnation	CAPACITOR Oil (Non PCB)	Residual voltage at energization	Not to exceed 10% of rated voltage				Altitude	Not exceeding 2,000m				Location	Indoor				Ambient air temperature	Please see following Table				Symbol	Ambient air temperature [°C]				Maximum	Minimum	Highest mean over any period of		24 h	1 year	B	+45	-25	+35	+25
Type	SEE DRAWING																																																							
Rated voltage [V]	720																																																							
Rated capacity [kvar]	SEE DRAWING																																																							
Phase [Φ]	3																																																							
Frequency [Hz]	50																																																							
Installation	INDOOR																																																							
Protection	IP20																																																							
Impregnation	CAPACITOR Oil (Non PCB)																																																							
Residual voltage at energization	Not to exceed 10% of rated voltage																																																							
Altitude	Not exceeding 2,000m																																																							
Location	Indoor																																																							
Ambient air temperature	Please see following Table																																																							
Symbol	Ambient air temperature [°C]																																																							
	Maximum	Minimum	Highest mean over any period of																																																					
			24 h	1 year																																																				
B	+45	-25	+35	+25																																																				

4. Tests and Electrical performances

4-1. Test conditions

Unless otherwise specified for a particular test or measurement, the temperature of the capacitor dielectric shall be in the range +5 °C to +35 °C.

4-2. Routine tests

a) Capacitance measurement

The capacitance shall be measured at 0.9 to 1.1 times the rated voltage and rated frequency.

The capacitance tolerance : -5% to +10% of rated capacity.

b) Capacitor loss tangent ($\tan \delta$) measurement

The capacitor loss tangent ($\tan \delta$) shall be measured at 0.9 to 1.1 times the rated voltage and rated frequency.

Dielectric loss	less than 0.35 W/kvar
Power loss with discharge device	less than 1.0 W/kvar

c) Voltage test between terminals

Voltage test between terminals shall be carried out with a voltage of :

$$U_T = 2.15 U_N$$

$$T_T = 10 \text{ seconds}$$

where

U_T is testing voltage (AC)

U_N is rated voltage of the capacitor.

T_T is testing time.

During the test, neither puncture nor flashover shall occur.

d) AC voltage test between terminals and container

Voltage test between terminals and container shall be carried out with a substantially sinusoidal voltage of :

$$U_T = 3 \text{ kV}$$

$$T_T = 10 \text{ seconds}$$

where

U_T is testing voltage.

T_T is testing time.

During the test, neither puncture nor flashover shall occur.

e) Test of internal discharge device

The resistance of the internal discharge device shall be checked by a resistance measurement.

The capacitors shall be provided with a means for reducing the residual voltage to 75 volts or less within three(3) minutes after the capacitor is disconnected from the source of supply.

f) Sealing test

Unenergized capacitor units shall be heated throughout so that all parts reach a temperature of at least equal to the maximum operating internal mean temperature,

but less than 65°C. This internal temperature shall be maintained for 3 h.

No leakage shall occur.

5. Overloads

5-1. Maximum permissible voltage

Capacitor units shall be suitable for operation at voltage levels according to table.

Type	Volt factor $\times U_n(\text{r.m.s})$	Maximum Duration
Power Frequency	1.00	Continuous
	1.10	8 h in every 24h
	1.15	30 min in every 24h
	1.20	5 min
	1.30	1 min

5-2. Maximum permissible current

A capacitor unit shall be suitable for continuous operation at an r.m.s current of 1.3 times the current that occurs at rated sinusoidal voltage and rated frequency, excluding transients.

5-3. Maximum permissible reactive power



A capacitor unit shall be suitable for continuous operation at 1.35 Q_n .

SPECIFICATION	CAPACITOR UNIT	4 / 7
<p>6. Markings</p> <ul style="list-style-type: none"> a) Name of manufacturer b) Identification number and manufacturing year c) Rated output Q_N in kilovars d) Rated voltage U_N in volts e) Rated frequency f_N in hertz f) Application standard g) Discharge device h) Insulation level i) Chemical or trade name of impregnation <p>7. Application Standard</p> <p>All capacitor furnished under this specification shall meet the design and testing requirement of IEC 60831-1</p> <p>8. Warranty</p> <p>We, the manufacturers, guarantee the quality and satisfactory operating when operated and maintained properly of the equipment supplied by us under this specification for the period of two years following the delivery date</p> <p>The guarantee shall be restricted to any damage on the equipment arising out of faulty materials or bad design or poor workmanship under proper use of equipment but not otherwise</p>		



SPECIFICATION

CAPACITOR UNIT

5 / 7

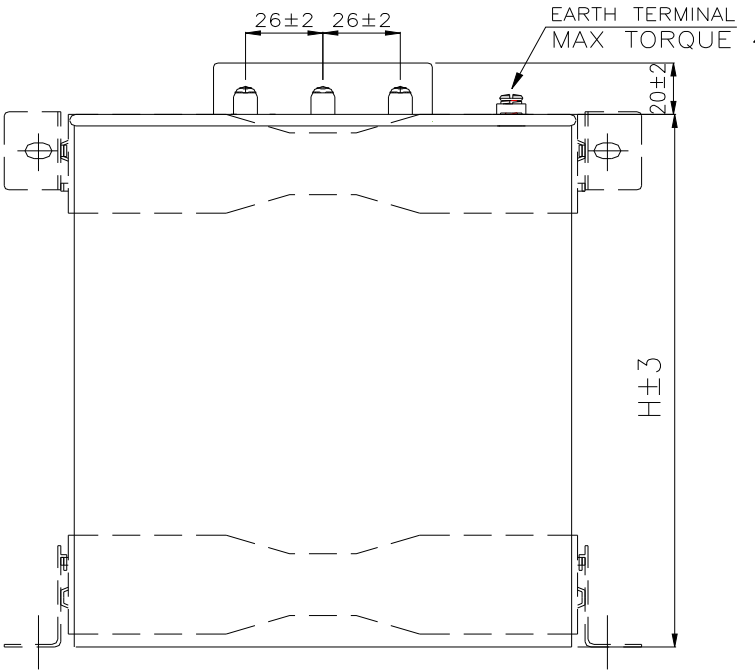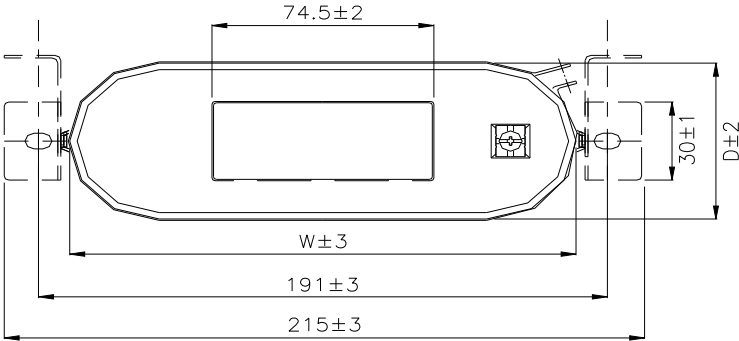

Part No.	MODEL	W (mm)	D (mm)	H (mm)	REMARK
MMS-725010KT	720VAC 3P 50Hz 10kvar	170	60	205	

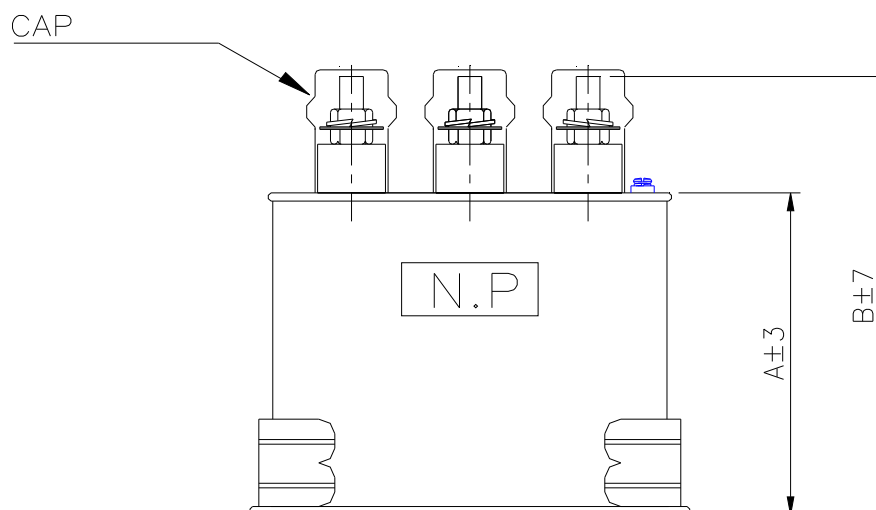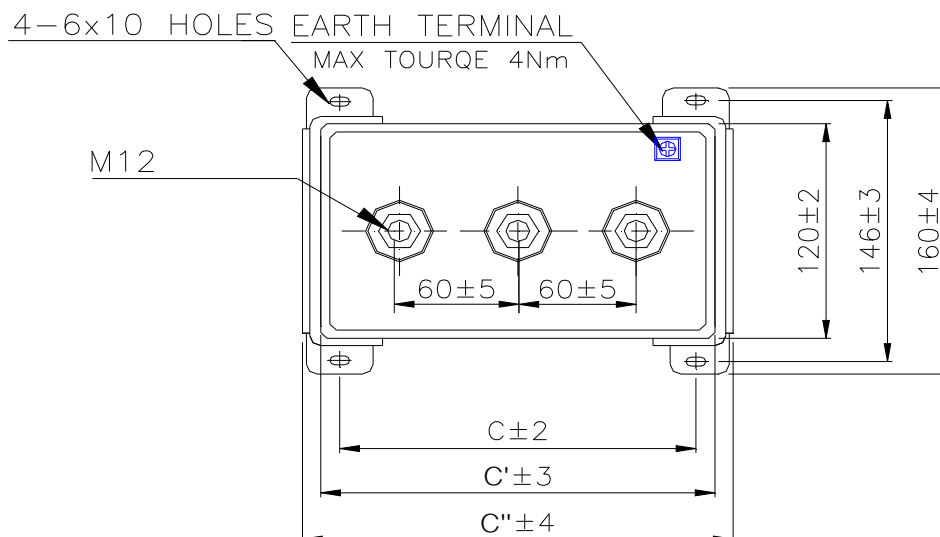SPECIFICATION
CAPACITOR UNIT
6 / 7


Part No.	Model	Dimension(mm)						Reamrk
		A±3	B±7	C±2	C' ±3	C''±4	D±5	
MMB-725020KT	720VAC 3P 50Hz 20kvar	180	240	170	200	210	60	
MMB-725025KT	720VAC 3P 50Hz 25kvar	190	250	170	200	210	60	
MMB-725030KT	720VAC 3P 50Hz 30kvar	260	320	170	200	210	60	
MMB-725040KT	720VAC 3P 50Hz 40kvar	290	350	170	200	210	60	
MMB-725050KT	720VAC 3P 50Hz 50kvar	310	370	170	200	210	60	

POWER CAPACITOR

SH IEC-60831:1996 NO PCB'S



Mikrocap Sdn.Bhd.Malaysia

Tel : 603-5192 7155 Fax: 603-5192 7166

www.itmikro.com

⚠ WARNING

1. A well-ventilated and dry place for installation.
 2. Surrounding temperature maintains less than the average 35 degree for 24hours (the average 25 degree for a year).
 3. Must be provided ventilator for forced air cooling when installing in the cubicle.
 4. Please keep the distance more than 60mm when multiple unit capacitor installs at a certain place.
 5. Must be used the permissible wire which endures more than 1.5times of rated current.
 6. Please check a complete electric discharge before reswitching. (don't reswitch within 3 minutes).
 7. Please check out a line connection to prevent from a loose.
 8. When capacitors are connected by parallel, please make a room of cable length to protect a bushing from heat expansion and contraction. (don't connect with a copper bus bar).
 9. Please fix a screw carefully.
 10. Please install a exclusive breaker for capacitor.
- We don't have any responsibility for problems casued by your ignorance of above rules.



Mikro[®]

POWER CAPACITOR

Voltage	VAC
---------	-----

Cap.	kvar
------	------

	uF
--	----

Phase	Ø
-------	---

Freq.	Hz
-------	----

Mikrocap Sdn. Bhd. Malaysia

Tel : 603-5192 7155 Fax: 603-5192 7166

www.itmikro.com